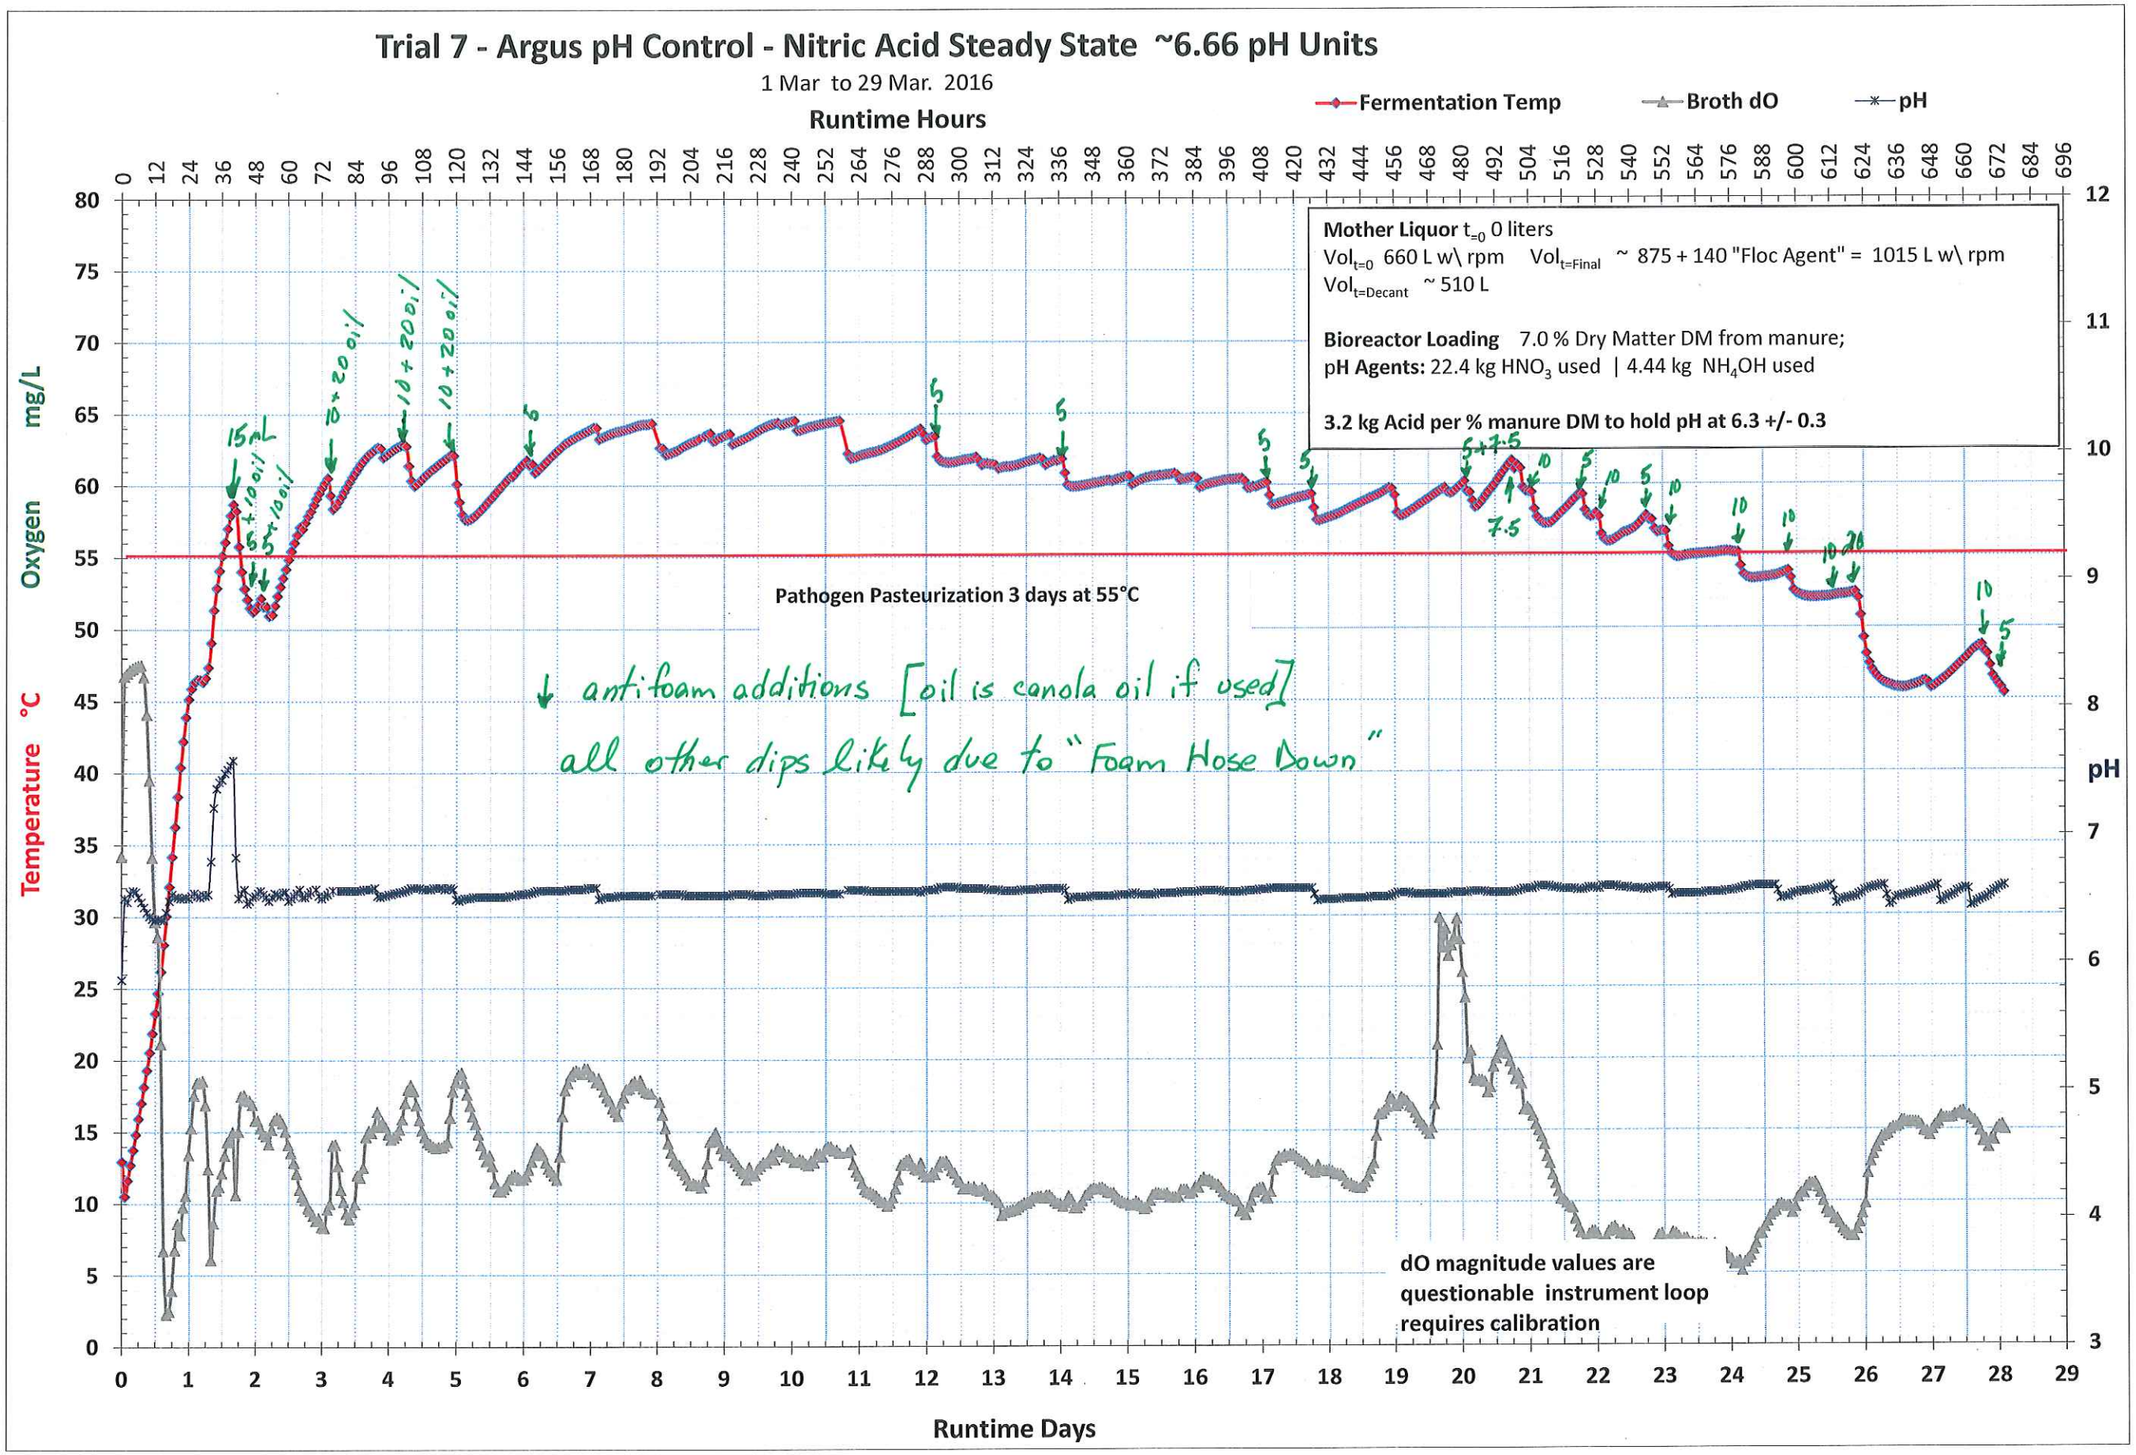

\\GOA\MyDocs\M\marc.legault\old_x_drive\1 CDC North\ACIDF 2015, 2016\Graph's and Data\Nitric Trial 7 to\Trial 7 Mar 2016\Graph Trial 7 Argus pH, dO, Temp. .xlsx
Graph Trial 7 pH, dO, Temp.

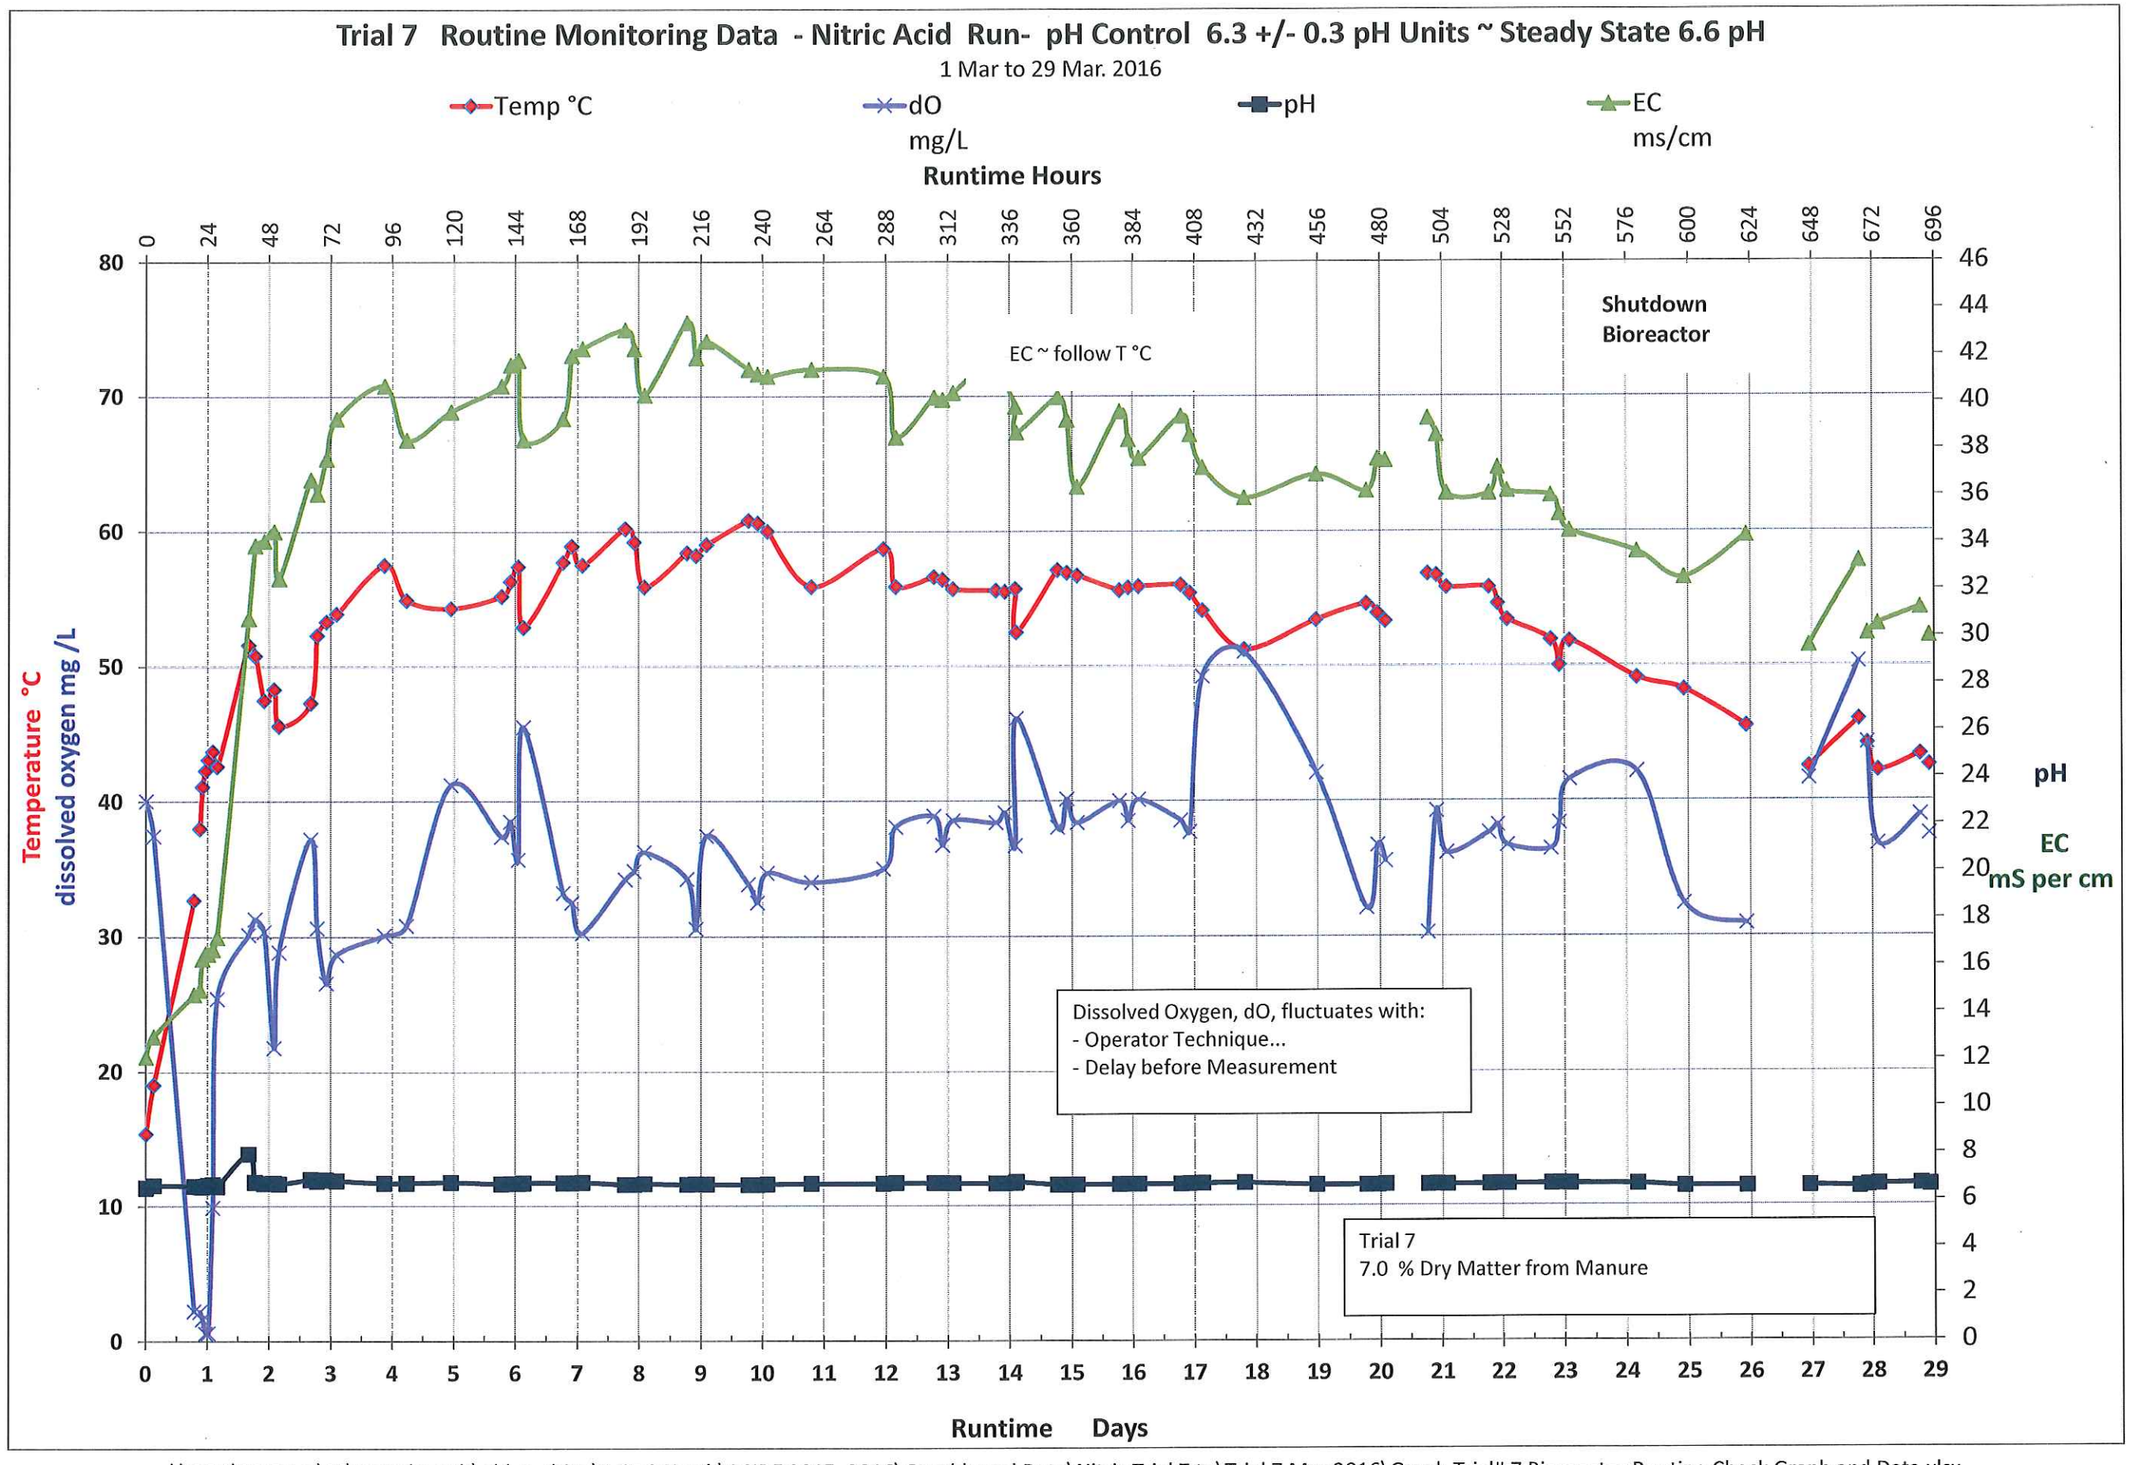
Trial 7 Routine Monitoring Data - Nitric Acid Run- pH Control 6.3 +/- 0.3 pH Units ~ Steady State 6.6 pH
1 Mar to 29 Mar. 2016
Temp °C
dO mg/L
pH
EC ms/cm
Runtime Hours
Temperature °C
dissolved oxygen mg /L
pH
EC mS per cm
EC ~ follow T °C
Shutdown Bioreactor
Dissolved Oxygen, dO, fluctuates with:
- Operator Technique...
- Delay before Measurement
Trial 7
7.0 % Dry Matter from Manure
Runtime Days