



Trial 7 pH Control Steady State 6.6 pH Units Nitric Acid
1 March to 29 March 2016

Dissolved Metals by ICP-OES

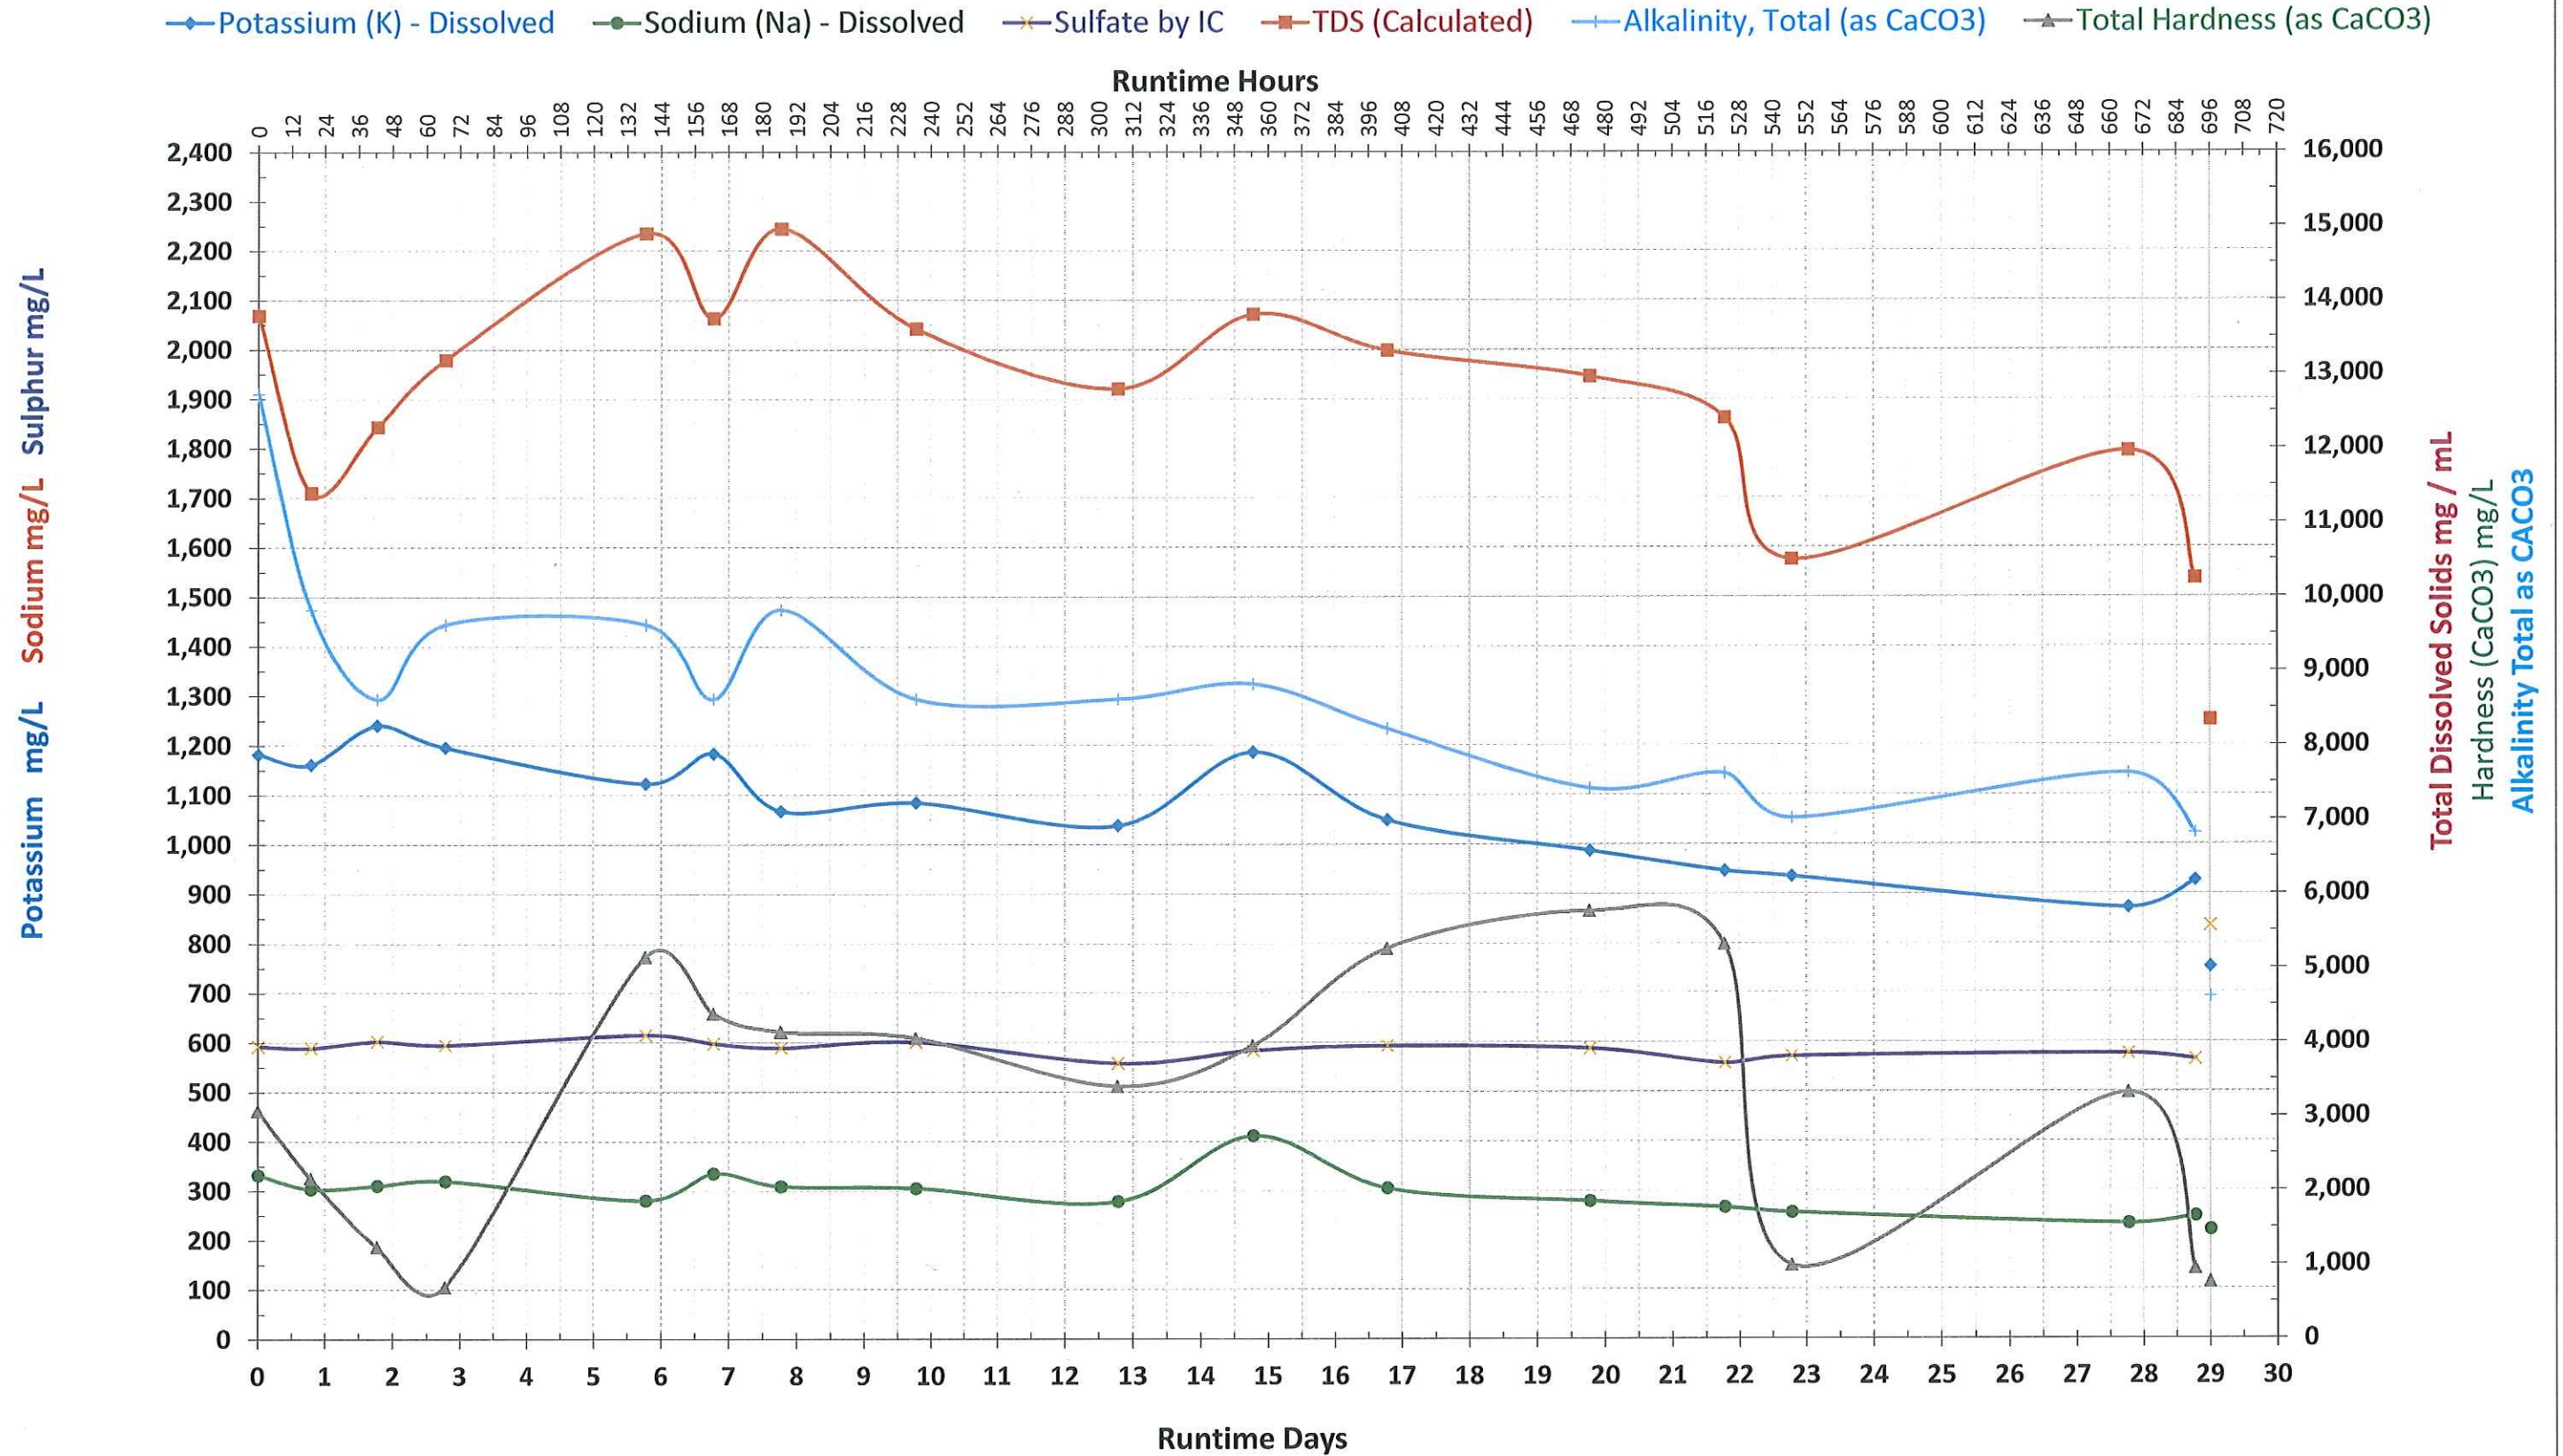


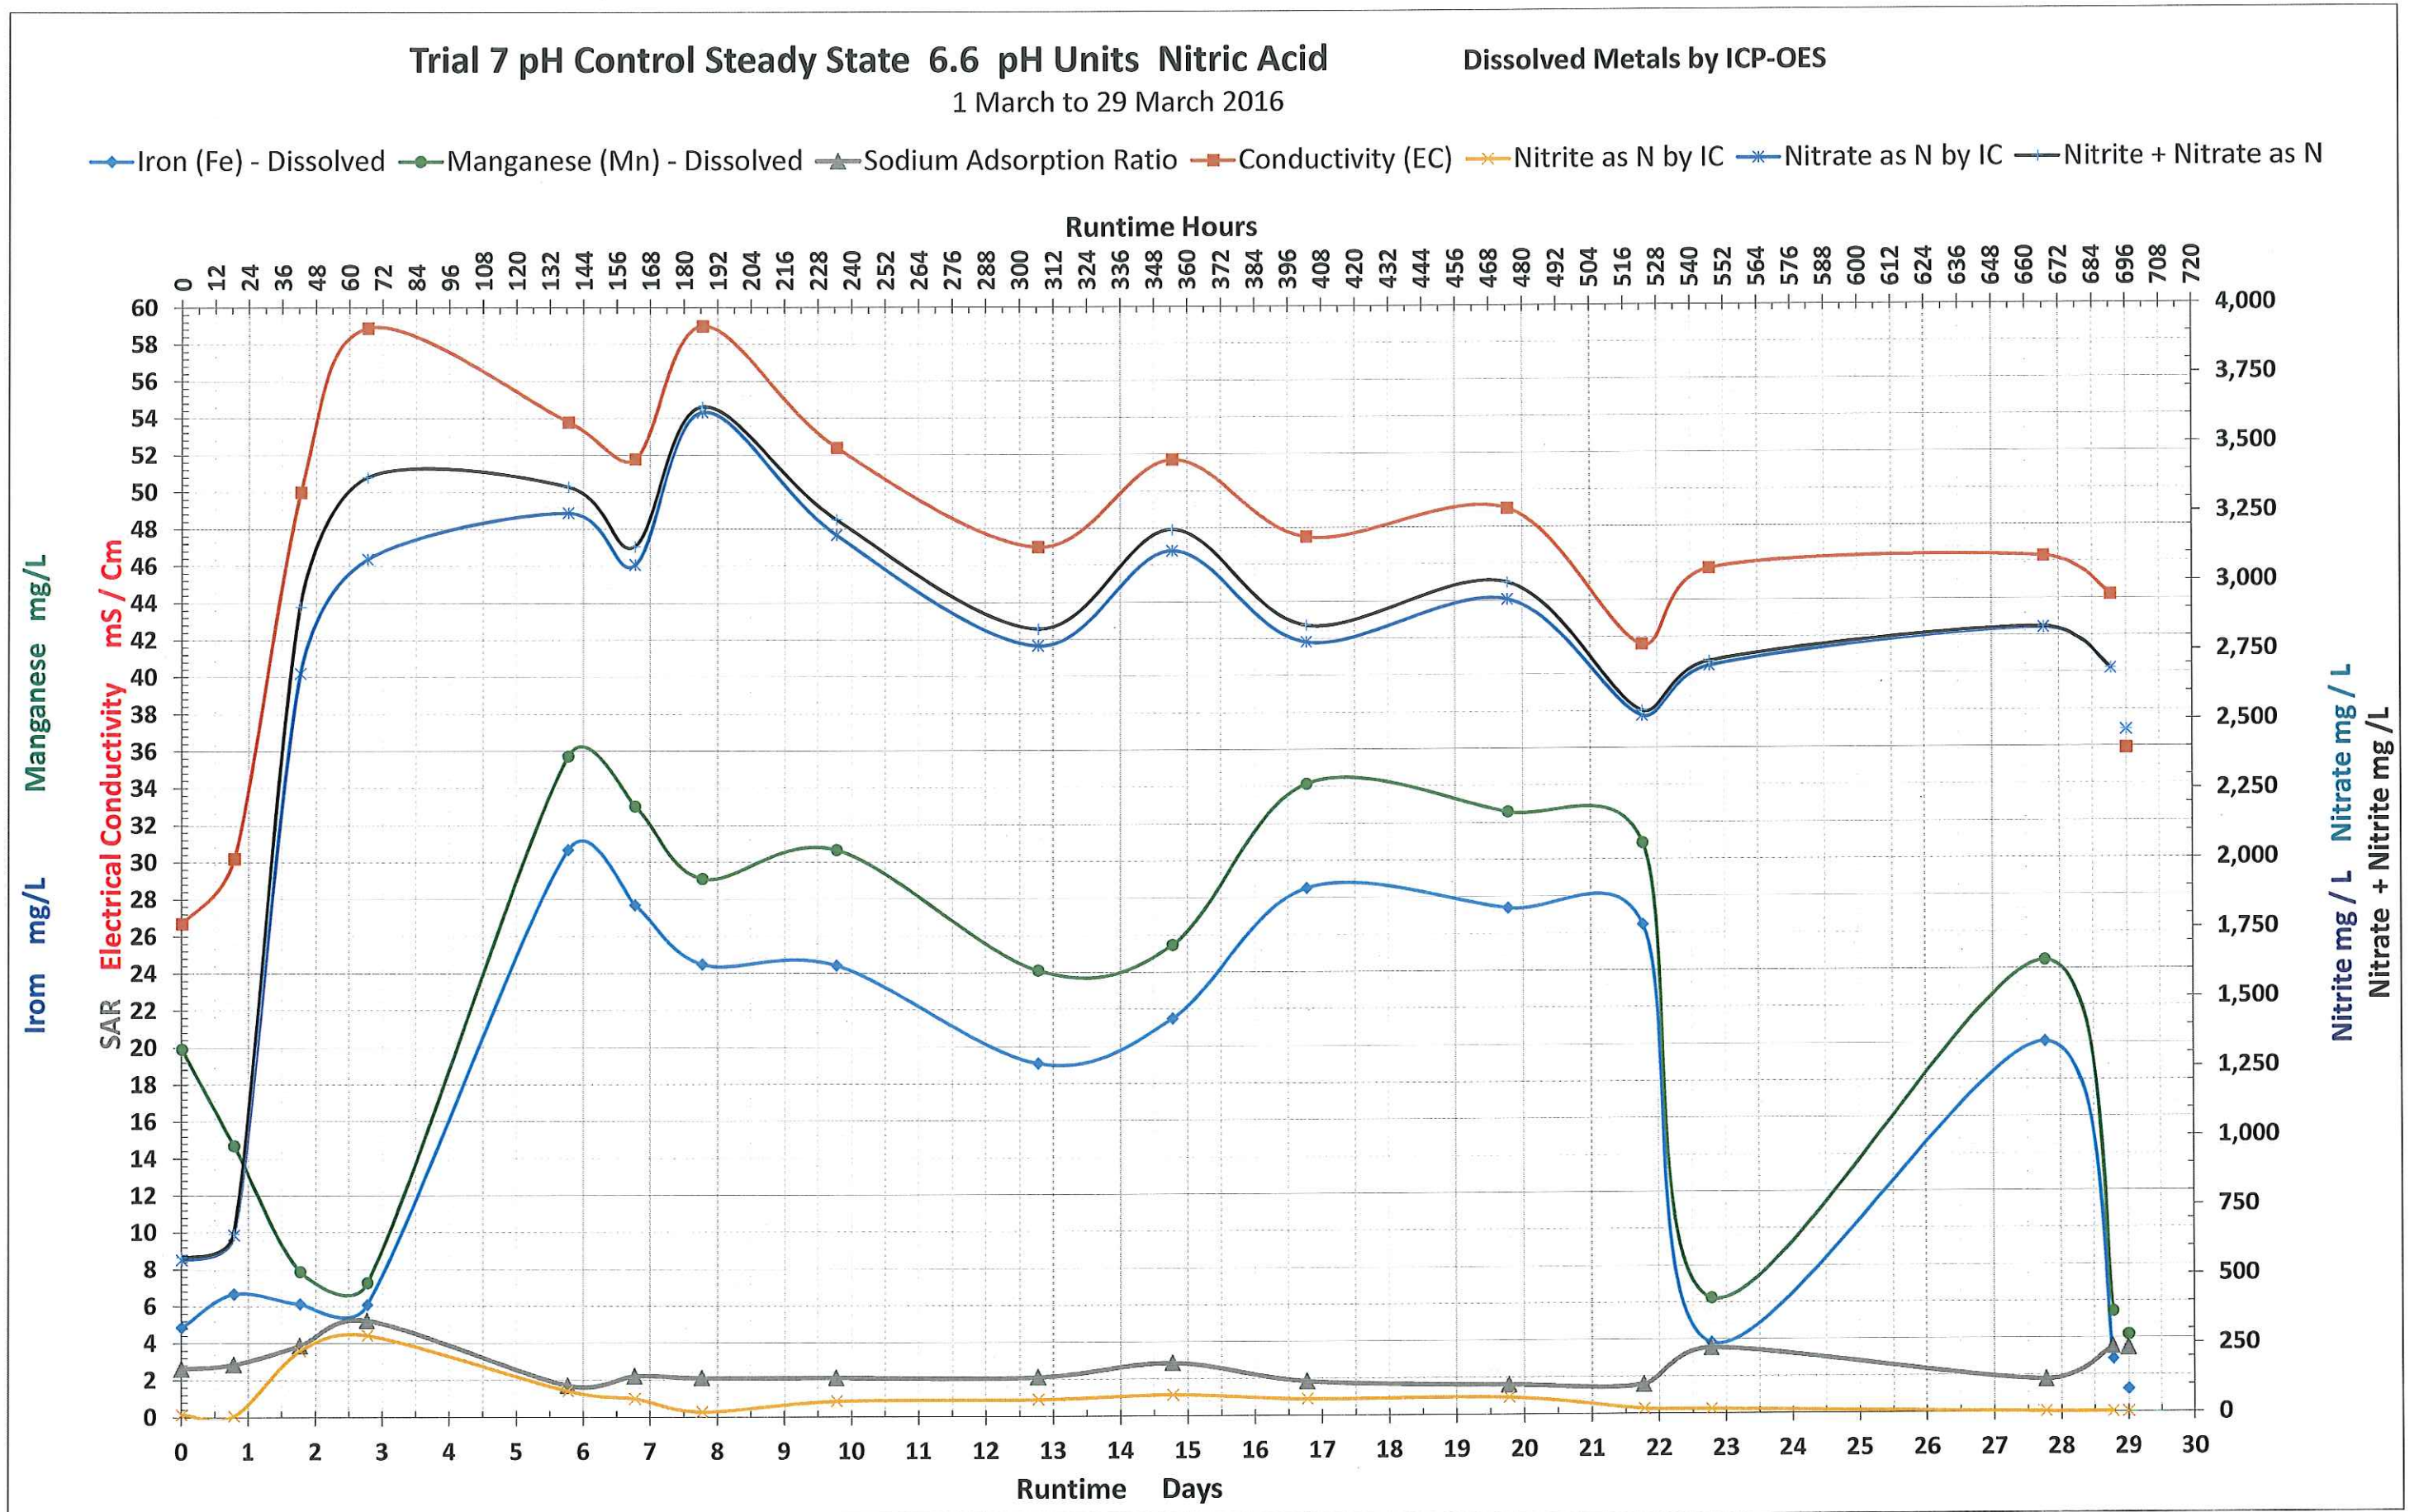

Trial 7 pH Control Steady State 6.6 pH Units Nitric Acid

Dissolved Metals by ICP-OES

1 March to 29 March 2016

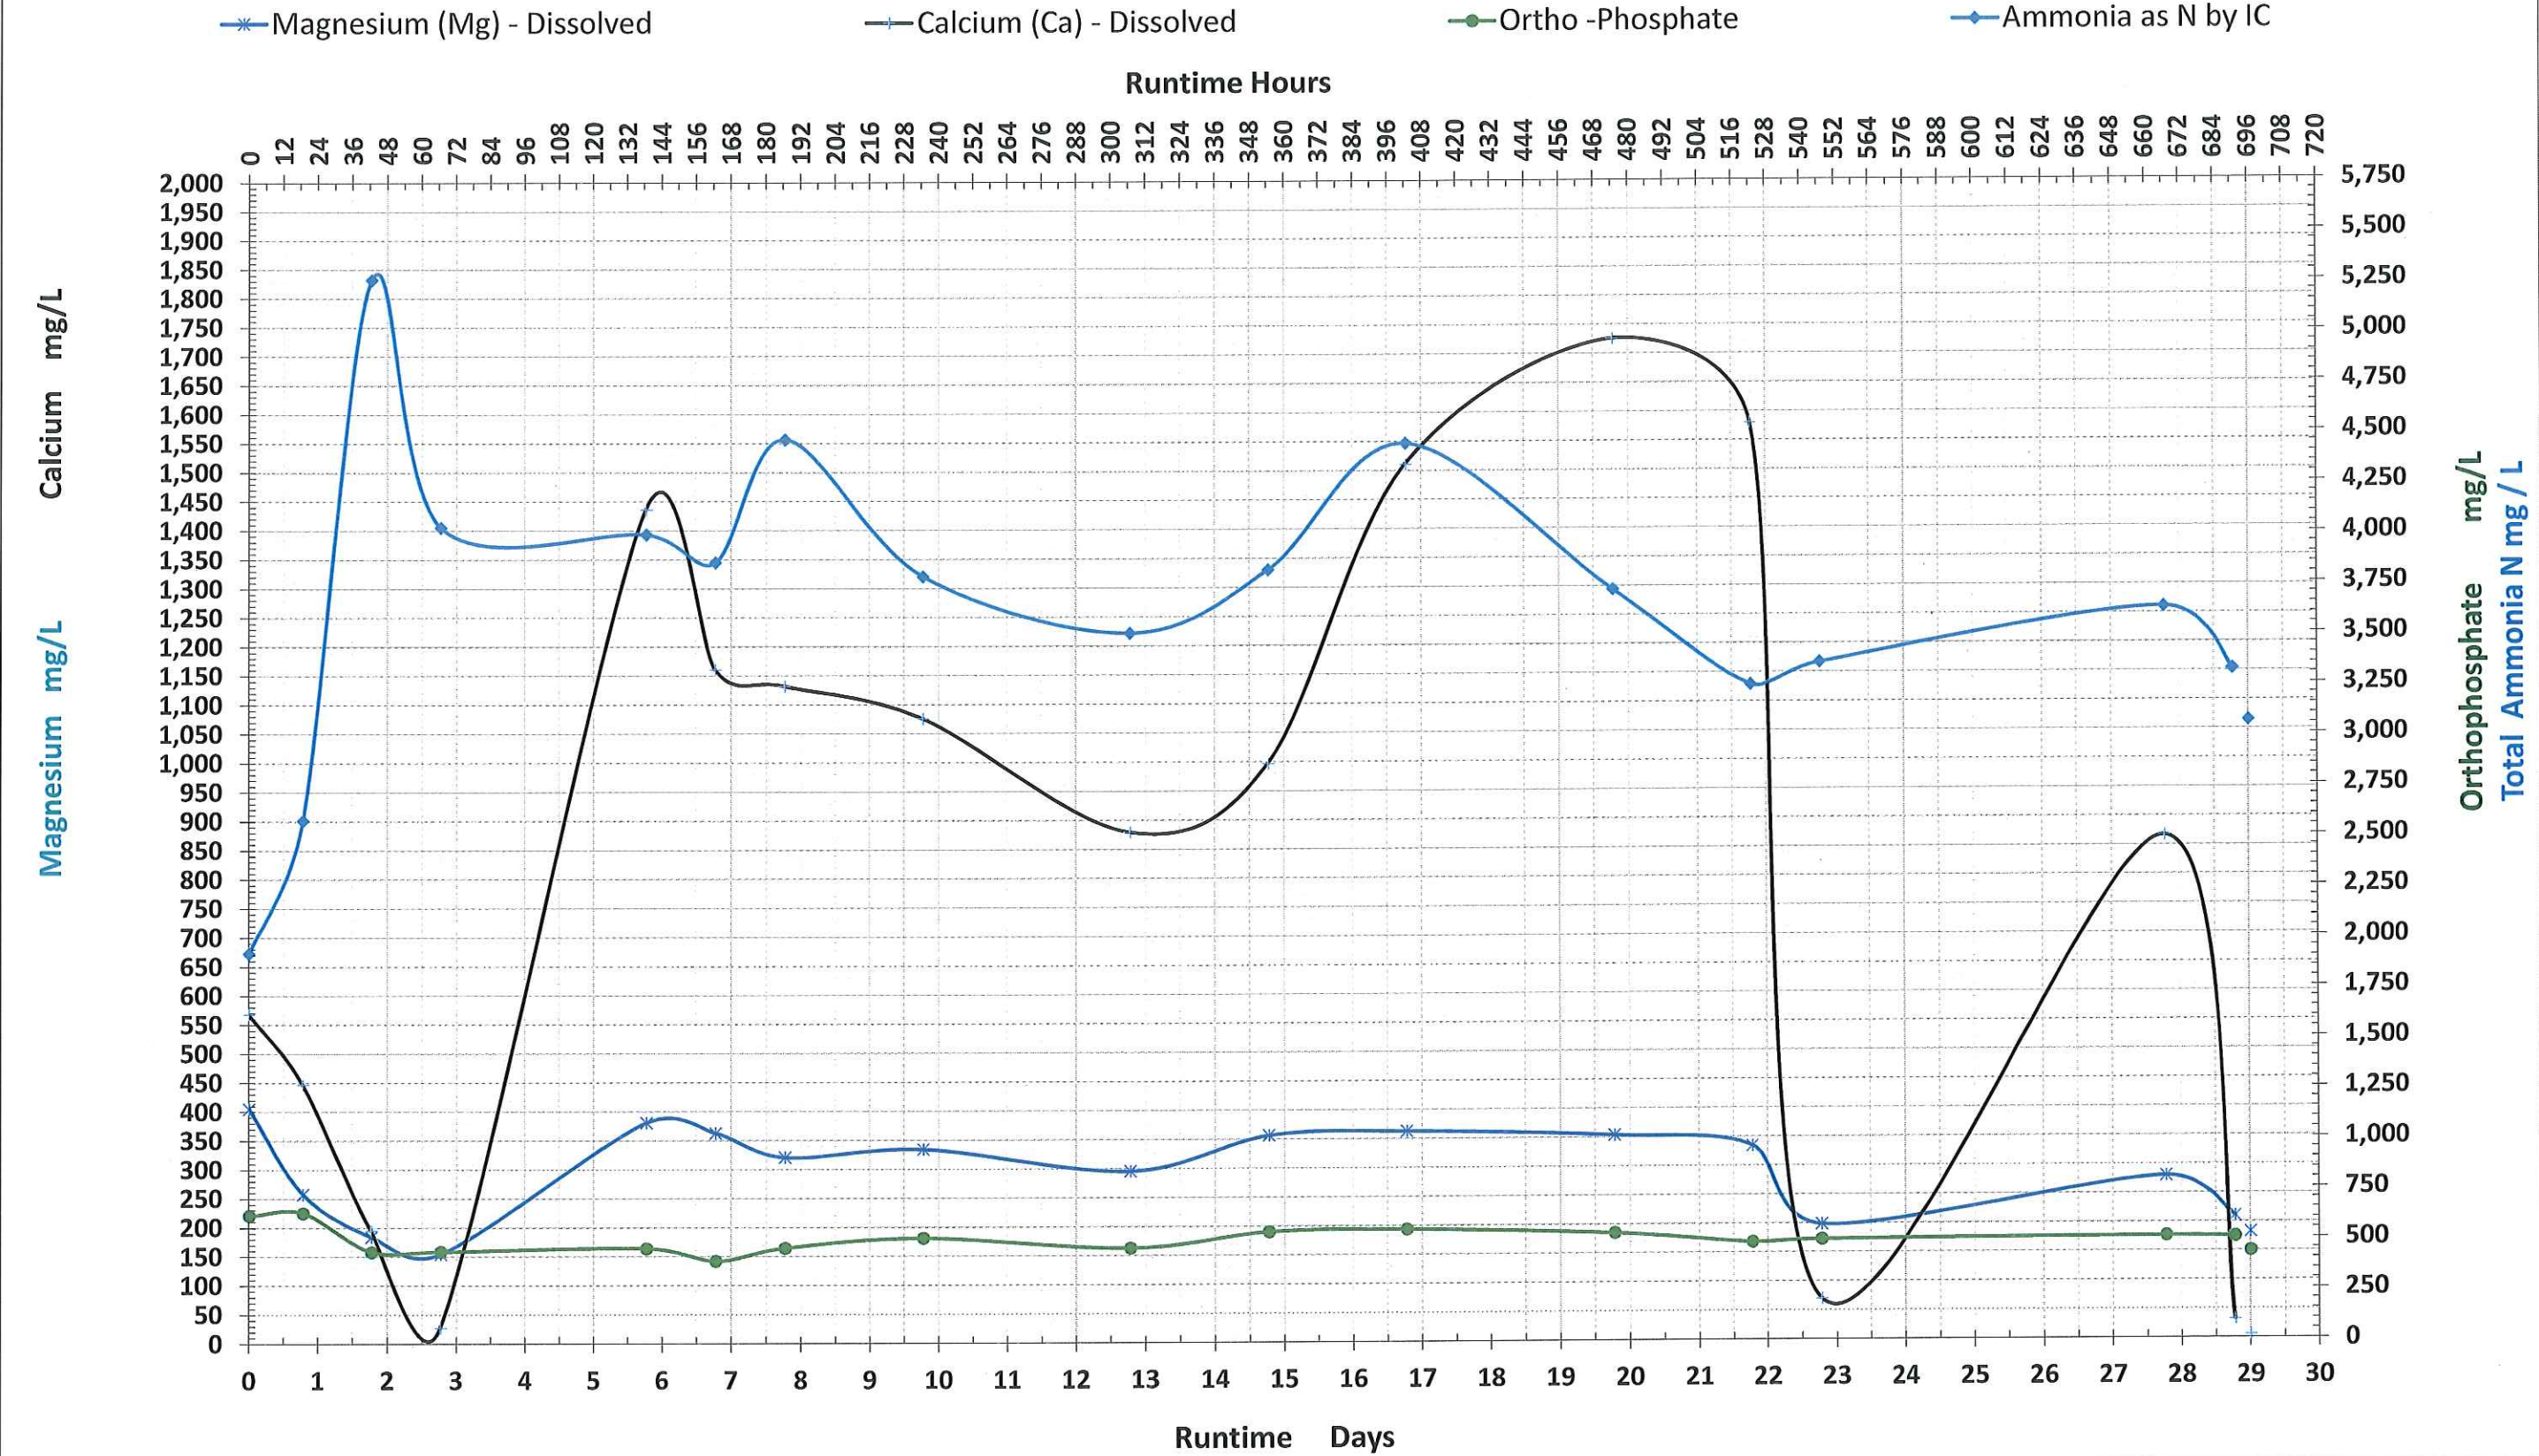


Trial 7 pH Control Steady State 6.6 pH Units Nitric Acid

1 March to 29 March 2016

—●— Chemical Oxygen Demand (COD)
 —■— Biological Oxygen Demand (BOD)

Runtime Hours

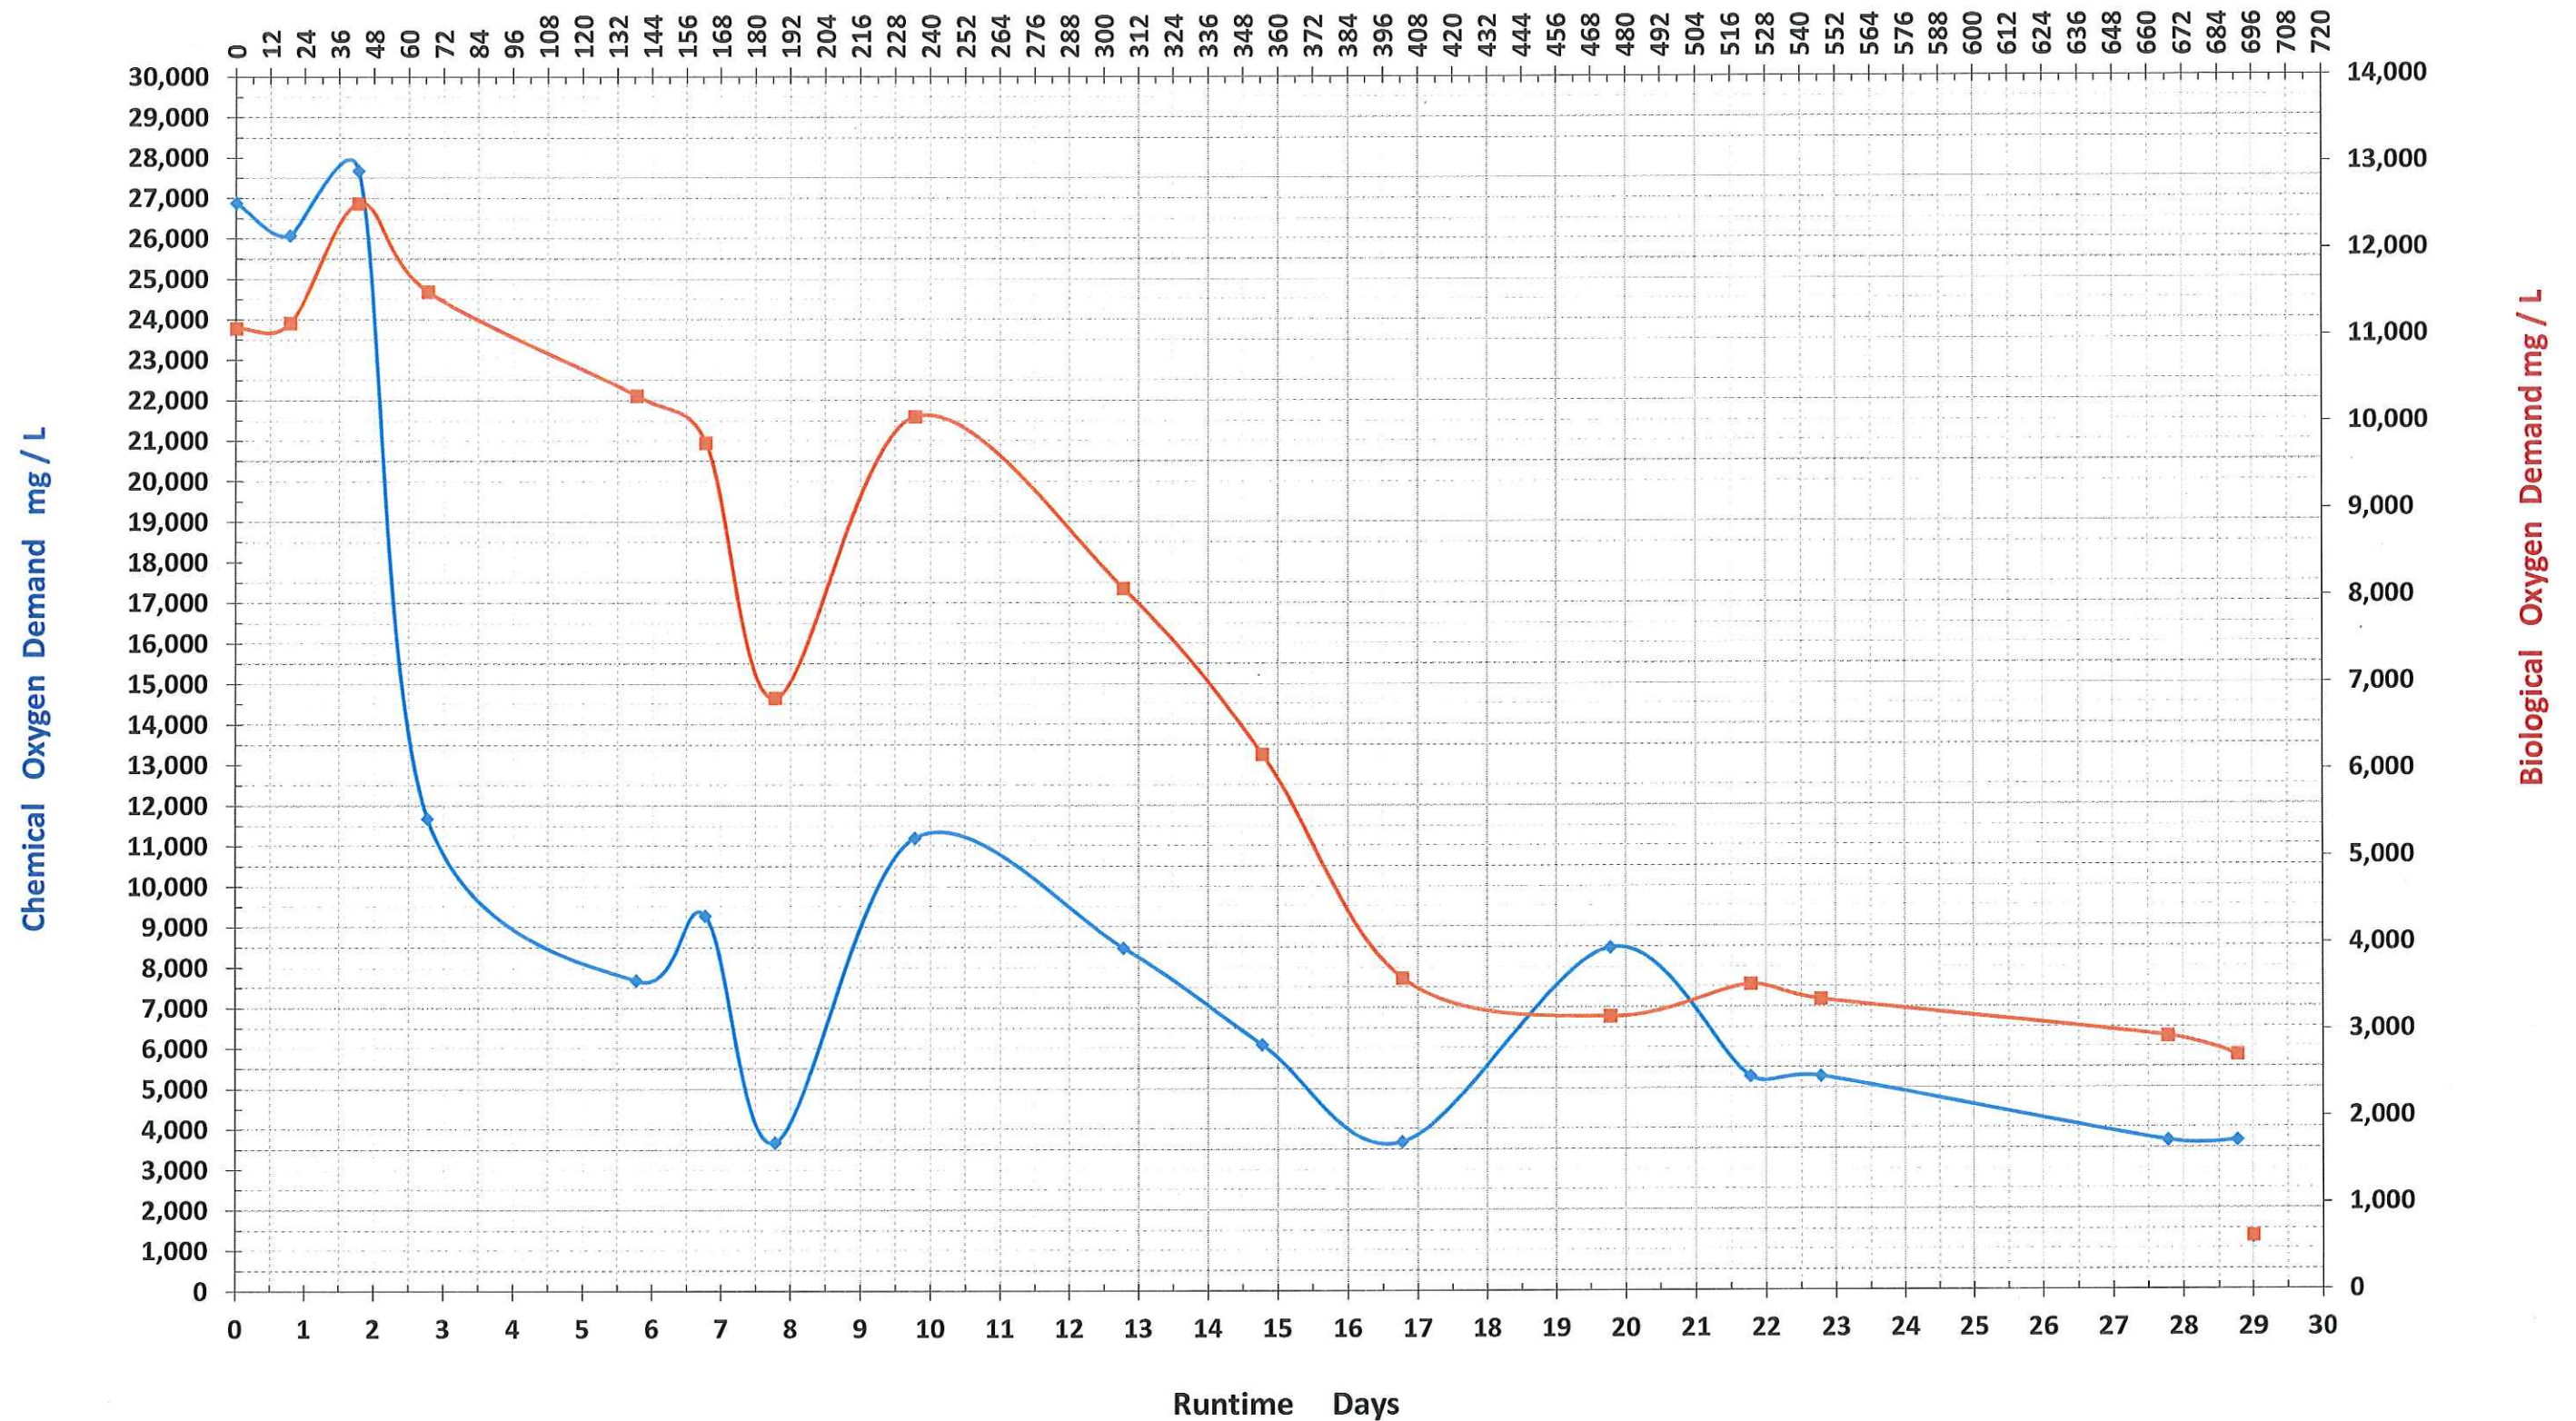


\\GOA\MyDocs\M\marc.legault\old_x_drive\1 CDC North\ACIDF 2015, 2016\Graph's and Data\Nitric Trial 7 to\Trial 7 Mar 2016\

Trial 7 Nutrient Data and Graphs .xlsx

Trial 7 pH Control Steady State 6.6 pH Units Nitric Acid

Extractable Metals by CRC ICPMS Graph 1

1 March to 29 March 2016

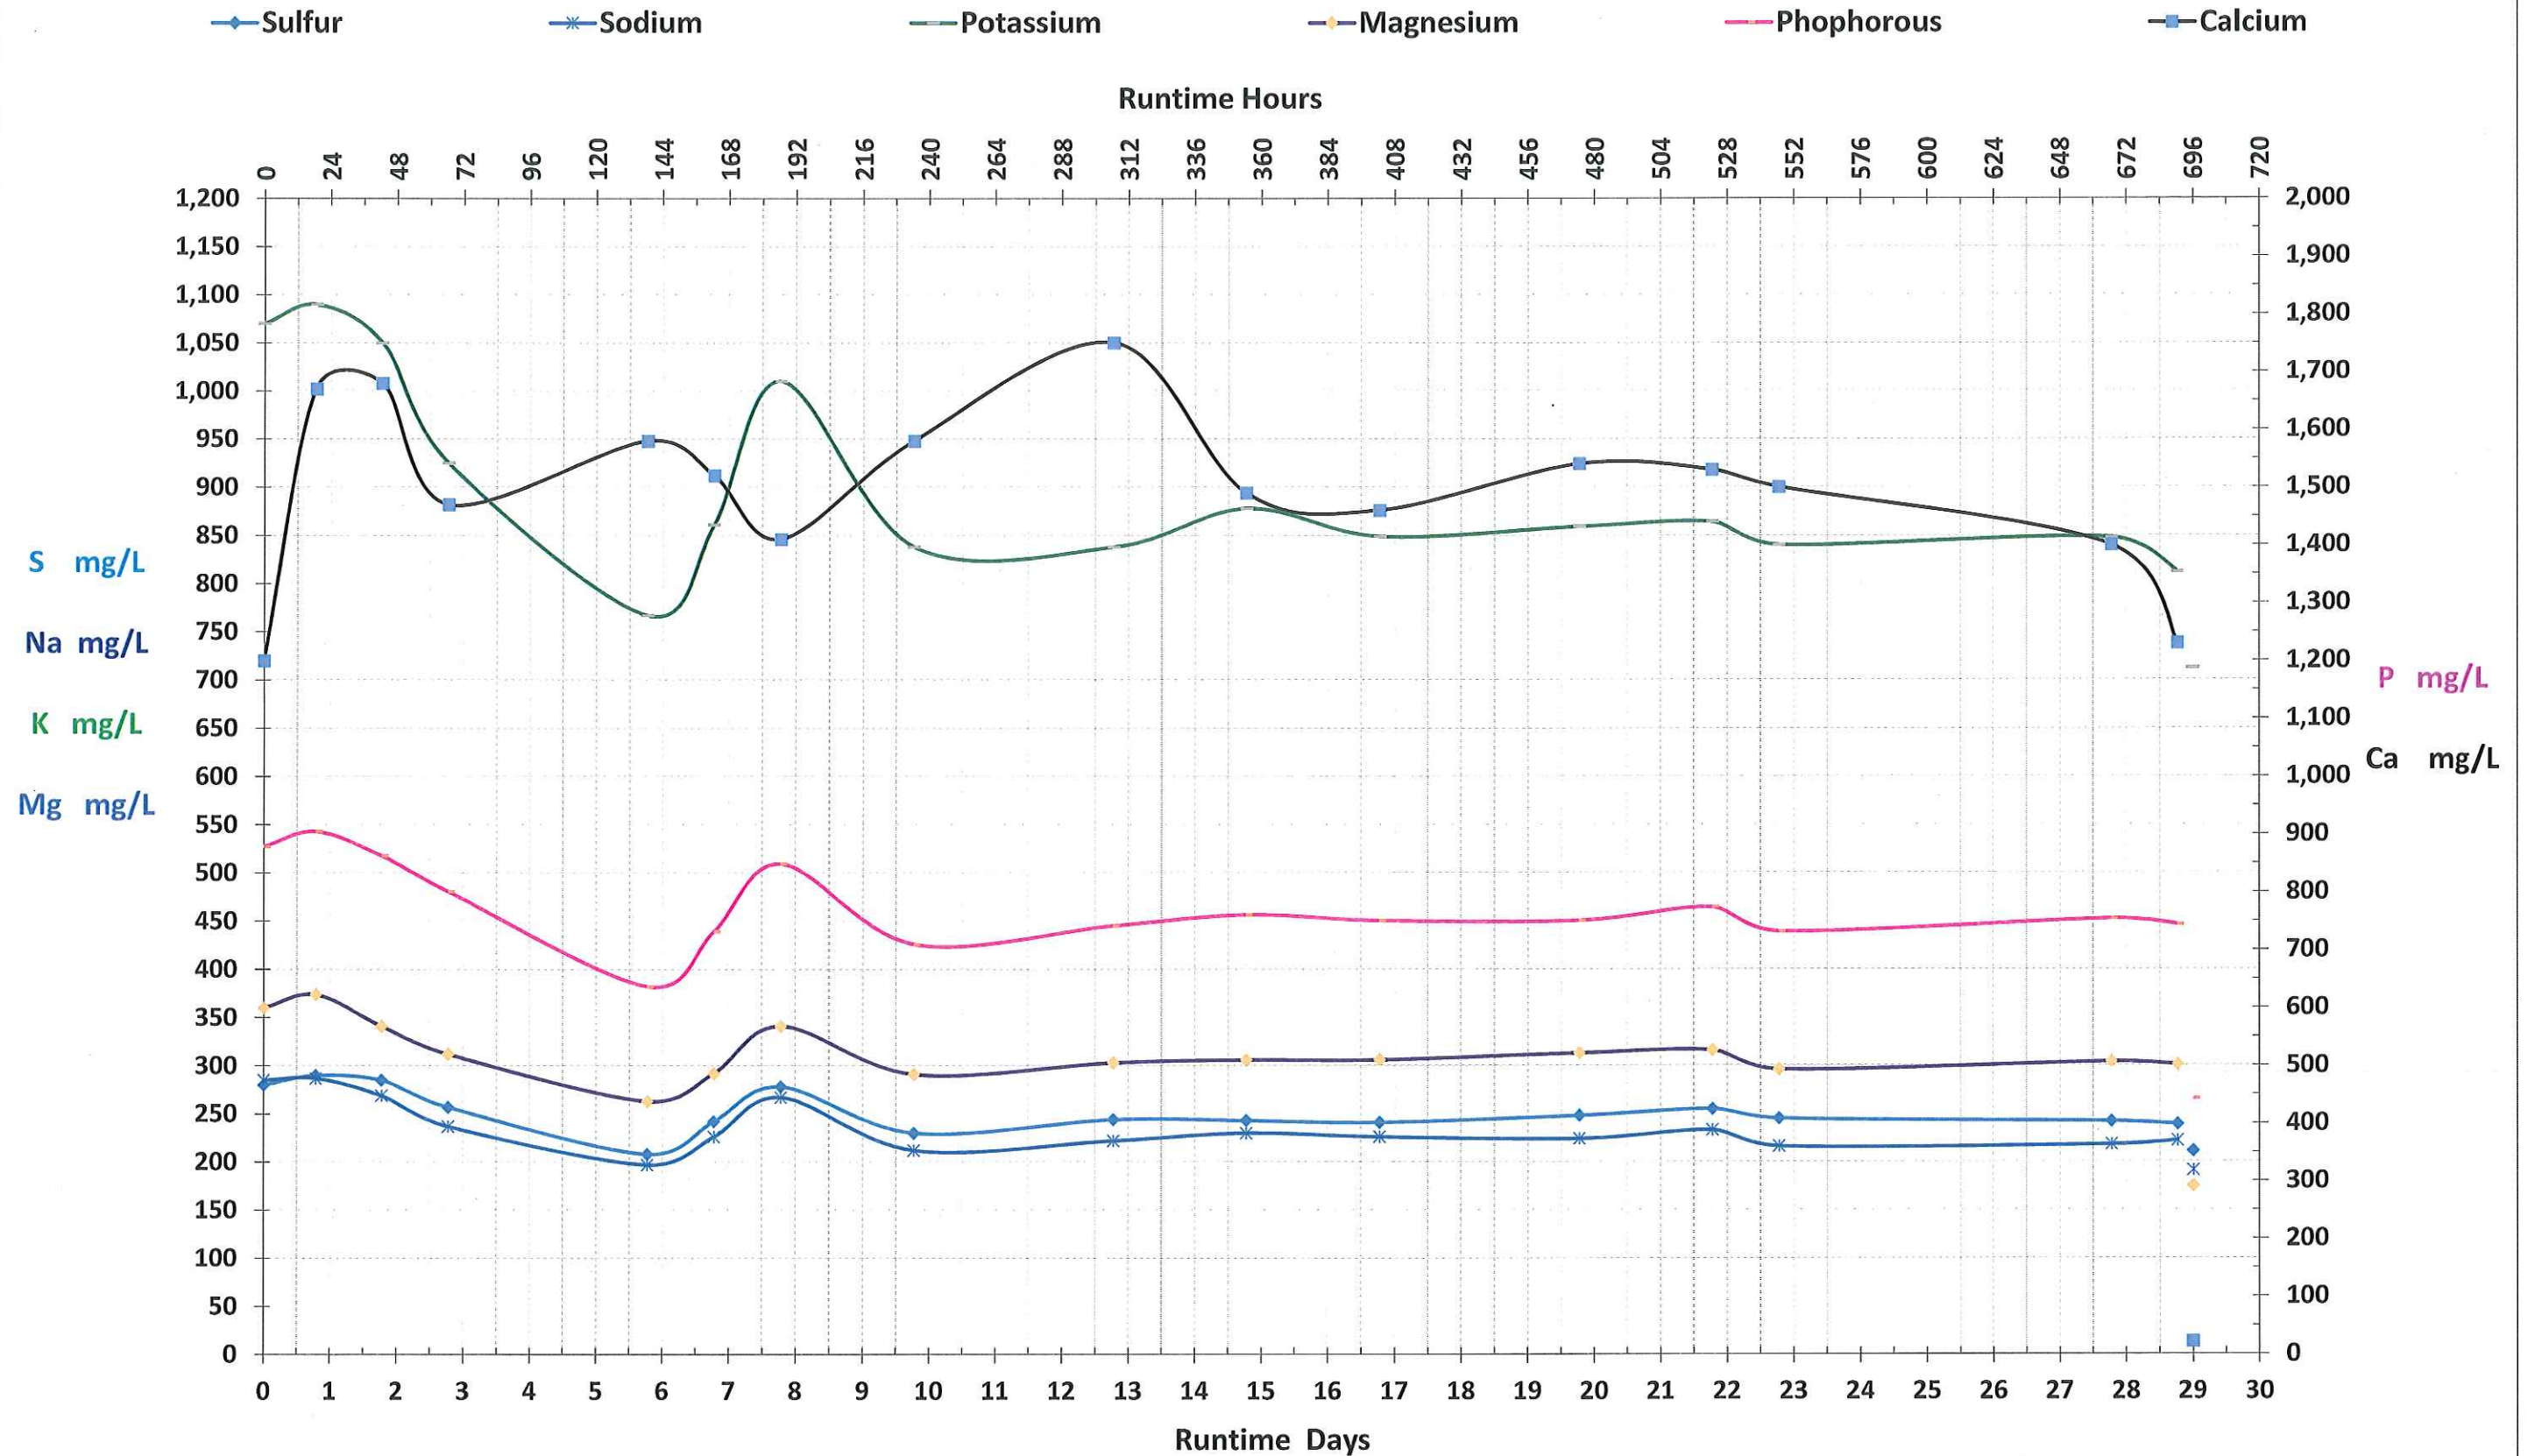

Trial 7 pH Control Steady State 6.6 pH Units Nitric Acid

Extractable Metals by CRC ICPMS Graph 2

1 March to 29 March 2016

